22nd Annual Pittsburgh Coal Conference

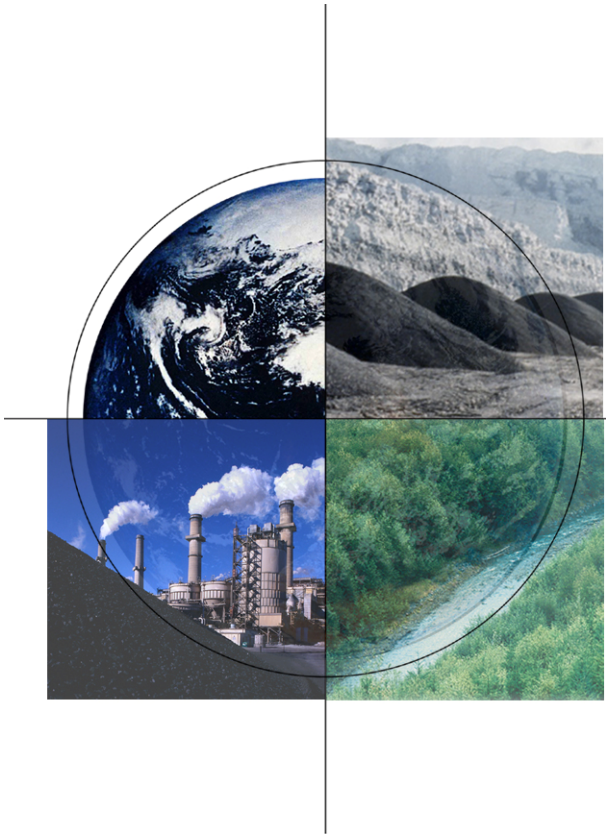

The PCO Process for Removal of Mercury from Flue Gas

Christopher R. McLarnon,
Evan J. Granite, and
Henry W. Pennline

September 13, 2005

National Energy Technology Laboratory

Office of Fossil Energy

GP-254 / PCO Process

- Alternative to ACI Developed
- Patent Issued June 2003
- Licensed for Application to Coal-Burning Power Plants (Powerspan Corporation)
- Oxidation of Mercury
- Irradiation of Flue Gas with 254-nm Light
- 90% Oxidation Attained at Bench-Scale
- Low Parasitic Power (less than 0.5%)
- Potential Application for Incinerators

Regulatory Drivers

- EPA Announcement March 15, 2005
- Clean Air Mercury Rule
- Several States Requiring Stricter Reductions
- 70-90% Removal Requirement
- Phased in Over Several Years

Fossil Energy Program Goals

Develop more effective mercury control options

- **Cost-effective and high level of mercury removal**
- **Meet long-term IEP program goal of 90% mercury reduction at cost reduction of 25-50%**
- **Must be better than ACI**

Technical Challenges

Mercury is Difficult to Capture

- Low concentration
- Exists as Hg^0
- Harsh conditions of coal-derived flue gas
- Competitive adsorption / poisoning
- Low sorbent reactivity
- Hg is semi-noble metal

ACI for Mercury Removal

- **Benchmark technology**
  - Deficiencies for flue gas applications
- **General adsorbent**
- **Limited temperature range**
- **Sequestration**
- **High sorbent / Hg ratio (3,000:1 to 100,000:1)**
- **Contacting methods**
- **Expensive: $1,000 - 3,000/ton**
- **500 MW_e power plant: $0.5 - 10 MM/yr**

Technical Challenges
Mercury is Difficult to Measure

- Low concentration & harsh conditions
- Exists as Hg, $HgCl_2$, and $Hg_{(particulate)}$
- Continuous conversion among three
- Broad-band absorbers
- Quenching
- Photosensitized oxidation
- Competitive adsorption/ poisoning

Background: GP-254 Process

Discovery

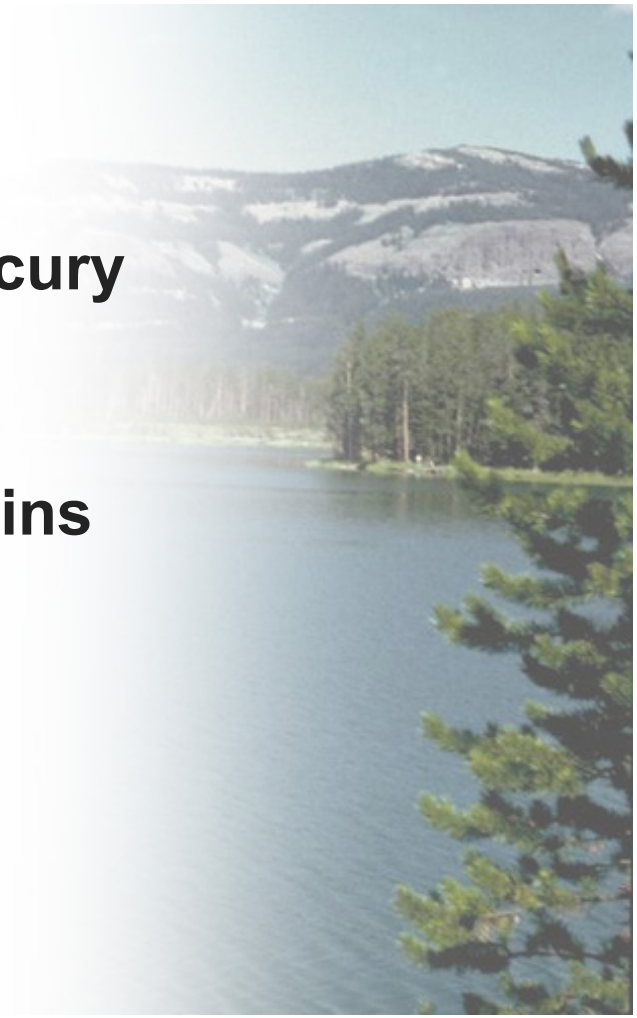

- Sorbent development
- UV measurement of mercury
- AFS
- Unwanted red-brown stains
- Mercuric oxide
- Serendipity

Photochemical Oxidation of Mercury

- Mercury can absorb and emit 253.7 nm light
- Atomic Absorption (AAS)

  $Hg + 253.7\ nm\ radiation \rightarrow Hg^*$ $\quad Hg\ 6\ (^3P_1)$ $\quad$ (I)

- Atomic Emission (AES)

  $Hg^* \rightarrow Hg + 253.7\ nm\ radiation$ $\quad$ (II)

- Atomic Fluorescence (AFS): steps (I) and (II)
- Basis for CEMs

What Is Quenching?

- Intensity of fluorescent emission diminished
- Energy transfer due to collisions
- Function of size, shape, and reactivity
- Primed for chemical reaction (activation)
- Interferes with ultraviolet spectroscopy

$Hg + 253.7\ nm\ light \rightarrow Hg^*$	$Hg\ 6\ (^3P_1)$
$Hg^* \rightarrow Hg + 253.7\ nm\ light$	Fluorescence
$Hg^* + M \rightarrow Hg + M^*$	Quenching

Quenching Cross Sections

$$Hg\ 6(^3P_1) + M \rightarrow Hg\ 6(^1S_0) + M^*$$

Function Of Size, Shape And Reactivity

Species	Cross Section (cm^2)
HCl	37.0×10^{-16}
NO	24.7×10^{-16}
O_2	13.9×10^{-16}
CO	4.1×10^{-16}
CO_2	2.5×10^{-16}
H_2O	1.0×10^{-16}
N_2	0.4×10^{-16}

Photochemical Oxidations

- First described in 1926 by Dickinson & Sherrill (O_2)
- Gunning discovered others in 1950s (HCl, H_2O, CO_2)

Relevant Overall Reactions

$Hg + 2\ O_2 + 253.7\ nm\ light \rightarrow$	$HgO + O_3$
$Hg + HCl + 253.7\ nm\ light \rightarrow$	$HgCl + 1/2\ H_2$
$Hg + H_2O + 253.7\ nm\ light \rightarrow$	$HgO + H_2$
$Hg + NO_2 + 253.7\ nm\ light \rightarrow$	$HgO + NO$
$Hg + CO_2 + 253.7\ nm\ light \rightarrow$	$HgO + CO$

- Interferes with UV-based CEMs
- Potential removal method

Lab-Scale Photoreactor

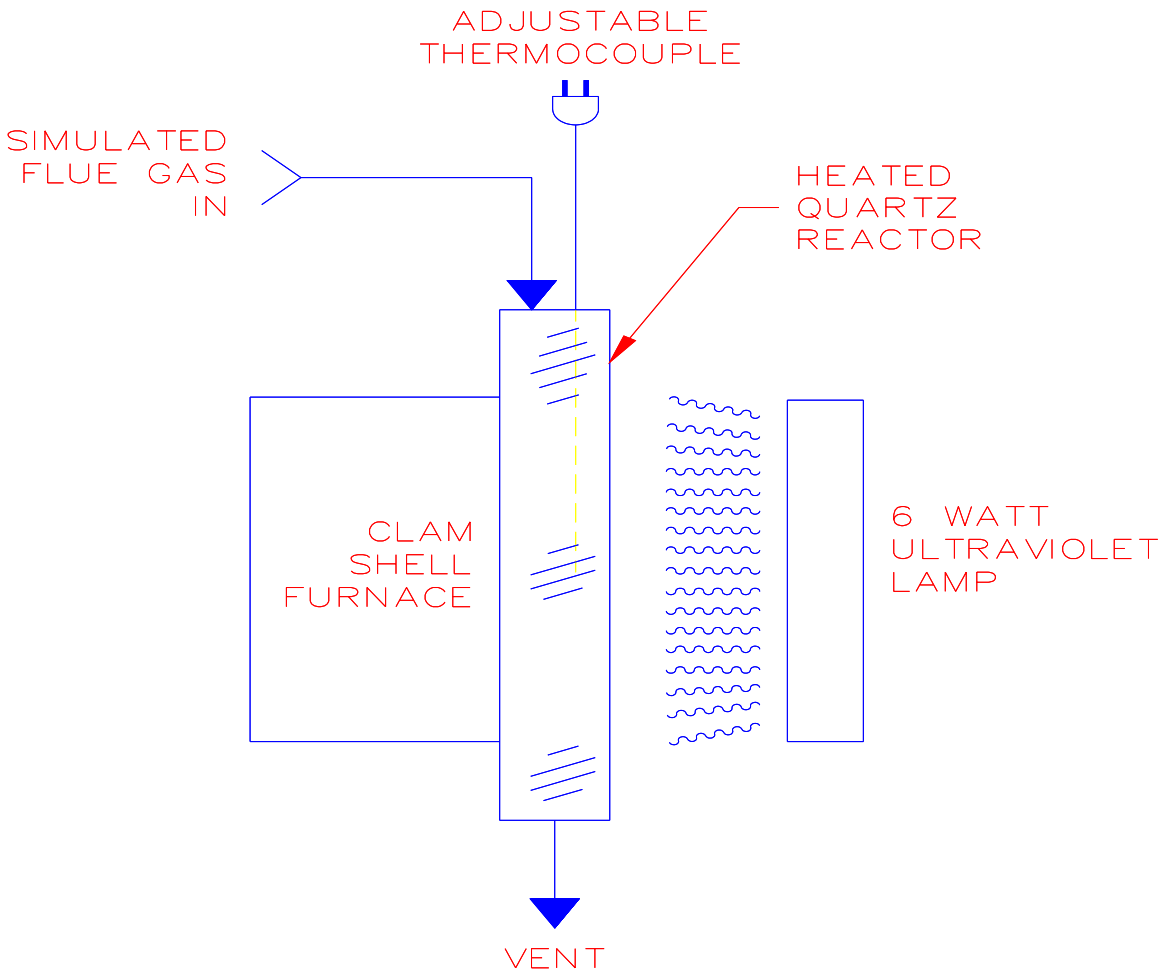

Photoreactor for Removal of Mercury

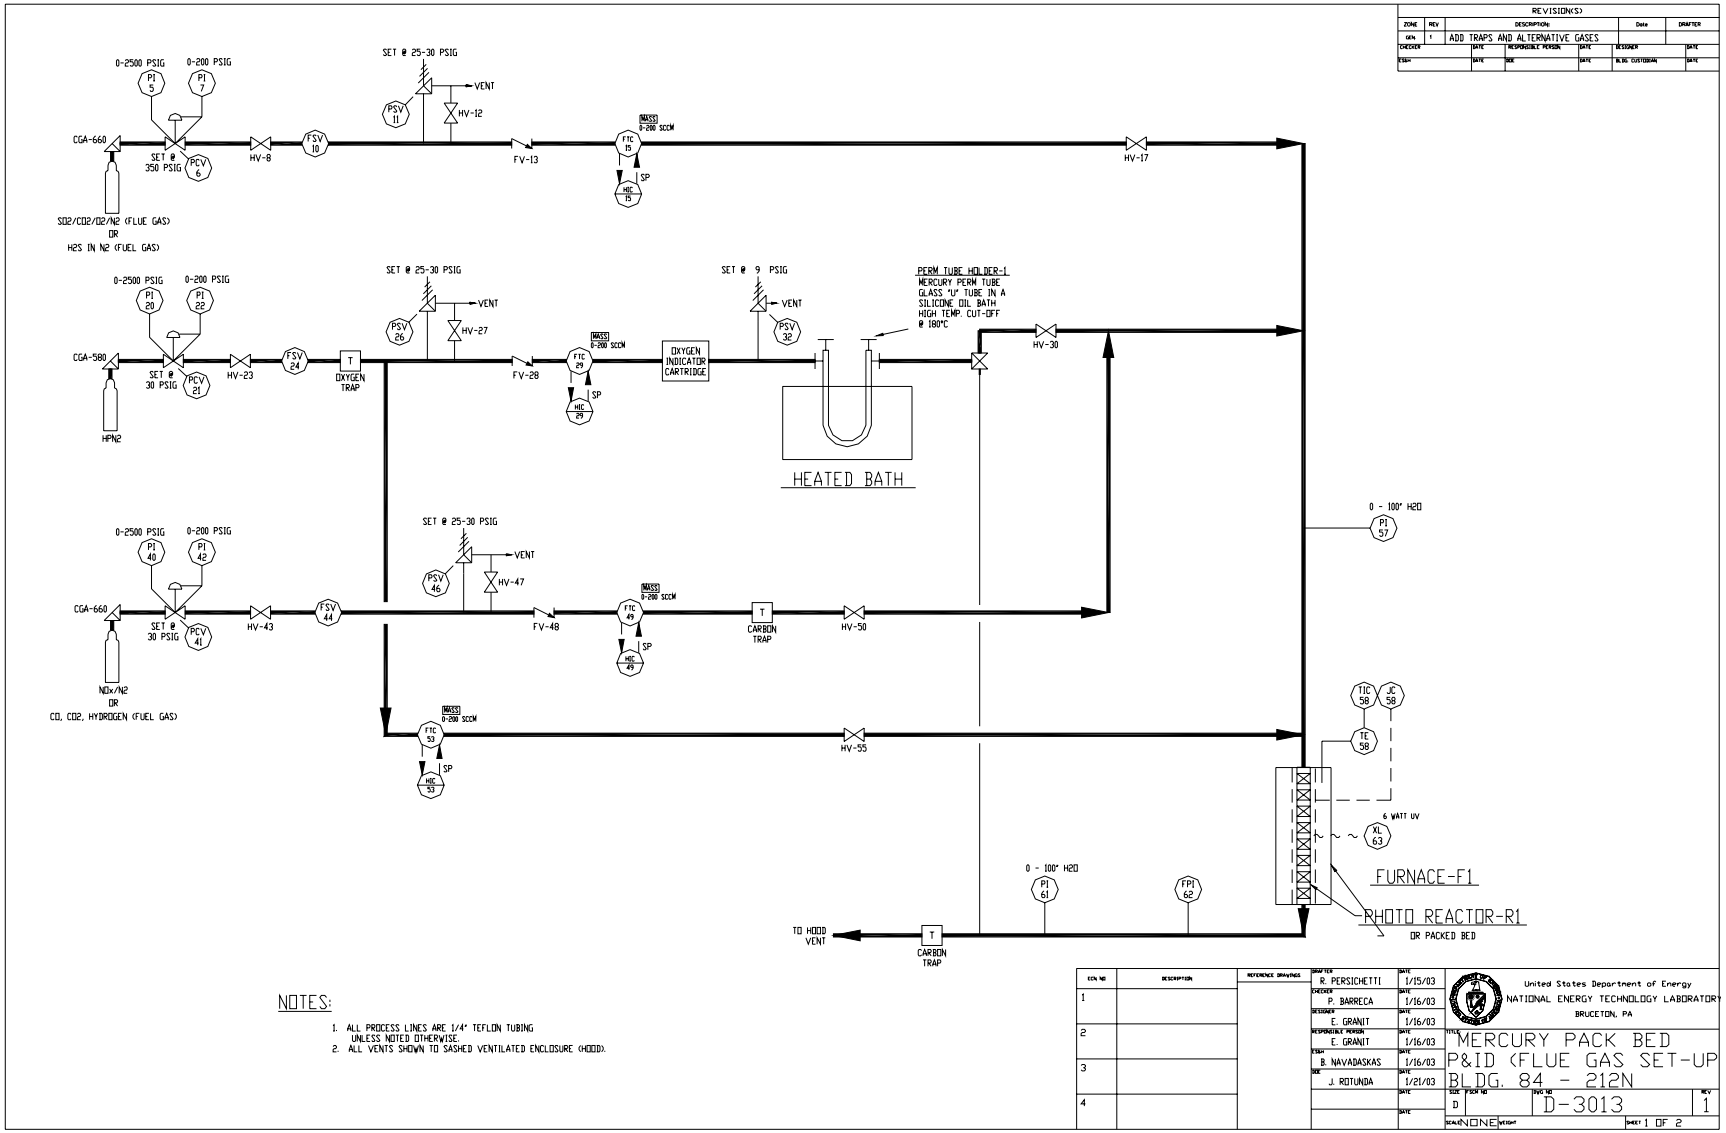
REVISION(S)
ZONE REV DESCRIPTION Date DRAFTER
GEN 1 ADD TRAPS AND ALTERNATIVE GASES
CHECKER DATE RESPONSIBLE PERSON DATE DESIGNER DATE
ESH DATE IBR DATE BLDG. CUSTODIAN DATE
0-2500 PSIG
0-200 PSIG
PI 5
PI 7
SET @ 350 PSIG
PCV 6
CGA-660
SO2/CO2/O2/N2 (FLUE GAS) OR H2S IN N2 (FUEL GAS)
HV-8
FSV 10
SET @ 25-30 PSIG
PSV 11
VENT
HV-12
FV-13
MASS 0-200 SCCM
FTC 15
HIC 15
SP
HV-17
0-2500 PSIG
0-200 PSIG
PI 20
PI 22
SET @ 30 PSIG
PCV 21
CGA-580
HPN2
HV-23
FSV 24
SET @ 25-30 PSIG
PSV 26
VENT
HV-27
T
OXYGEN TRAP
FV-28
MASS 0-200 SCCM
FTC 29
HIC 29
SP
OXYGEN INDICATOR CARTRIDGE
SET @ 9 PSIG
PSV 32
VENT
PERM TUBE HOLDER-1
MERCURY PERM TUBE
GLASS "U" TUBE IN A
SILICONE OIL BATH
HIGH TEMP. CUT-OFF
@ 180°C
HEATED BATH
HV-30
0-2500 PSIG
0-200 PSIG
PI 40
PI 42
SET @ 30 PSIG
PCV 41
CGA-660
NOx/N2 OR CO, CO2, HYDROGEN (FUEL GAS)
HV-43
FSV 44
SET @ 25-30 PSIG
PSV 46
VENT
HV-47
FV-48
MASS 0-200 SCCM
FTC 49
HIC 49
SP
T
CARBON TRAP
HV-50
MASS 0-200 SCCM
FTC 53
HIC 53
SP
HV-55
0 - 100" H2O
PI 57
TIC 58
JC 58
TE 58
6 WATT UV
XL 63
FURNACE-F1
RHOTO REACTOR-R1
OR PACKED BED
0 - 100" H2O
PI 61
FPI 62
TO HOOD VENT
T
CARBON TRAP
NOTES:
1. ALL PROCESS LINES ARE 1/4" TEFLON TUBING UNLESS NOTED OTHERWISE.
2. ALL VENTS SHOWN TO SASHED VENTILATED ENCLOSURE (HOOD).
ECN NO DESCRIPTION REFERENCE DRAWINGS
1
2
3
4
DRAFTER R. PERSICHETTI 1/15/03
CHECKER P. BARRECA 1/16/03
DESIGNER E. GRANIT 1/16/03
RESPONSIBLE PERSON E. GRANIT 1/16/03
ESH B. NAVADASKAS 1/16/03
IBR J. ROTUNDA 1/21/03
United States Department of Energy
NATIONAL ENERGY TECHNOLOGY LABORATORY
BRUCETON, PA
TITLE
MERCURY PACK BED
P&ID (FLUE GAS SET-UP
BLDG. 84 - 212N
SIZE D
DWG NO D-3013
REV 1
SCALE NONE WEIGHT
SHEET 1 OF 2

Experimental Parameters

- Quartz Photoreactor, 6-watt UV lamp
- Temperatures: 80°F, 280°F, 350°F
- Flow-rate: 60 ml/min Reaction time: 350 min
- Intensity: 1.4 mW/cm^2

Gas Compositions

A: 16% CO_2, 5% O_2, 2000 ppm SO_2, 300 ppb Hg, balance N_2

B: 16% CO_2, 5% O_2, 2000 ppm SO_2, 500 ppm NO, 300 ppb Hg, balance N_2

Results: Photochemical Removal

Gas	Temp (ºF)	Mean Hg Capture (%)
A	350	2.3 ± 2.0
A	280	71.6 ± 30.1
A	80	67.8 ± 28.8
B	280	26.8 ± 11.7

- Removal as mercuric oxide/mercurous sulfate stain
- Higher removals below 300ºF
- Limited by thermal decomposition of O_3 (300-350ºF)
- NO reduces removal, possibly by consuming ozone
- Low energy consumption
- Potentially low operating costs

Conclusions: Photochemical Oxidation

Method For Mercury Removal

- Obvious interference For CEMs
- High levels of mercury removal from SFG
- Capture as HgO and Hg_2SO_4
- Enhanced removal below 300ºF

Conclusions: Photochemical Oxidation

Potential For Better Performance

- Other oxidants (HCl, H_2O, NO_2) in flue gas
- Promising process economics
- Potential for multi-pollutant control
- Pilot-scale data needed
- Low rank coals are of particular interest

Larger Scale Testing
Bench-Scale Photoreactor

- Slipstream of flue gas from 500-lb/hr pilot
- Temperature: 280ºF - 350ºF
- Effect of temperature, radiation intensity residence time & composition
- Removals measured on-line by CEM
- Impact upon other flue gas species
- Determine GP-254 process economics

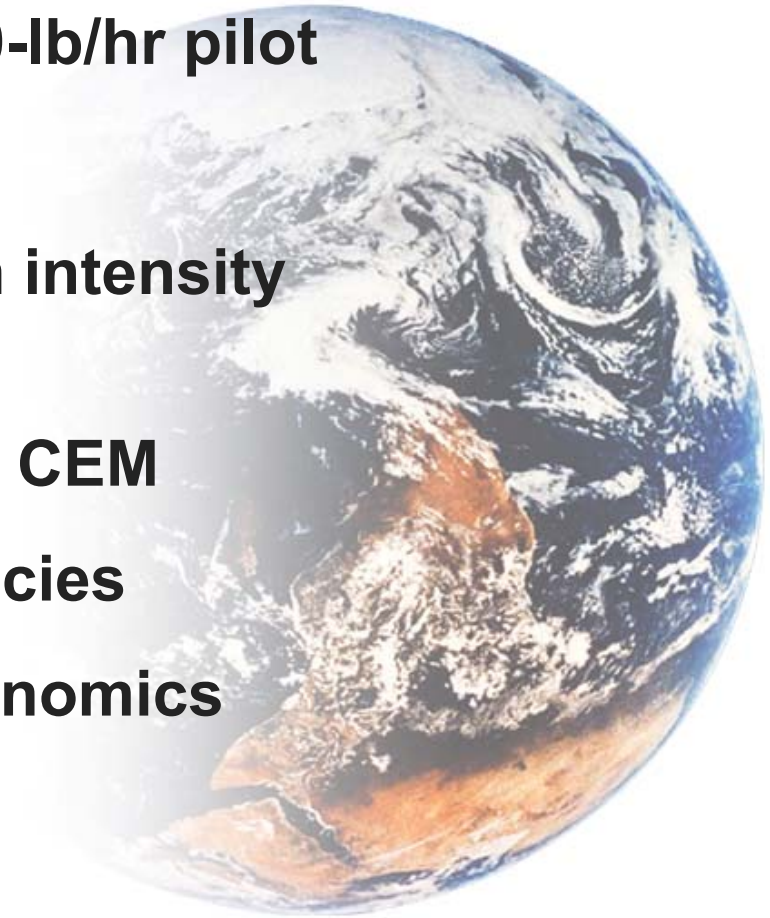

NETL BENCH-SCALE PHOTOREACTOR

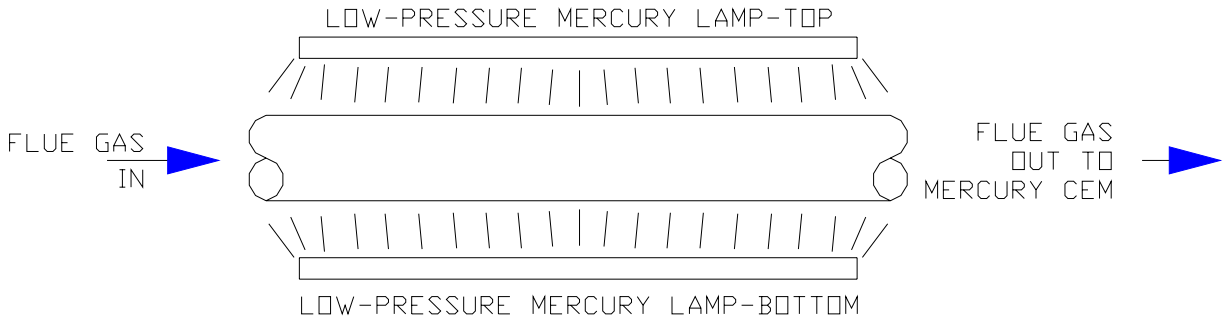

NETL Bench-Scale Photoreactor

- ½-inch by 33-inch Quartz Tube
- Two 30-W Low Pressure Mercury Lamps
- 254-nm Intensity: 20 mW/cm^2
- Gas Composition: PRB Flue Gas
- Temperature: 120^{o}F - 280^{o}F
- Flow-Rate: 8 liters/min
- Sir Galahad CEM Monitor Inlet/Outlet Mercury

SCHEMATIC DIAGRAM OF THE NETL 500-LB/HR COAL COMBUSTION TEST FACILITY

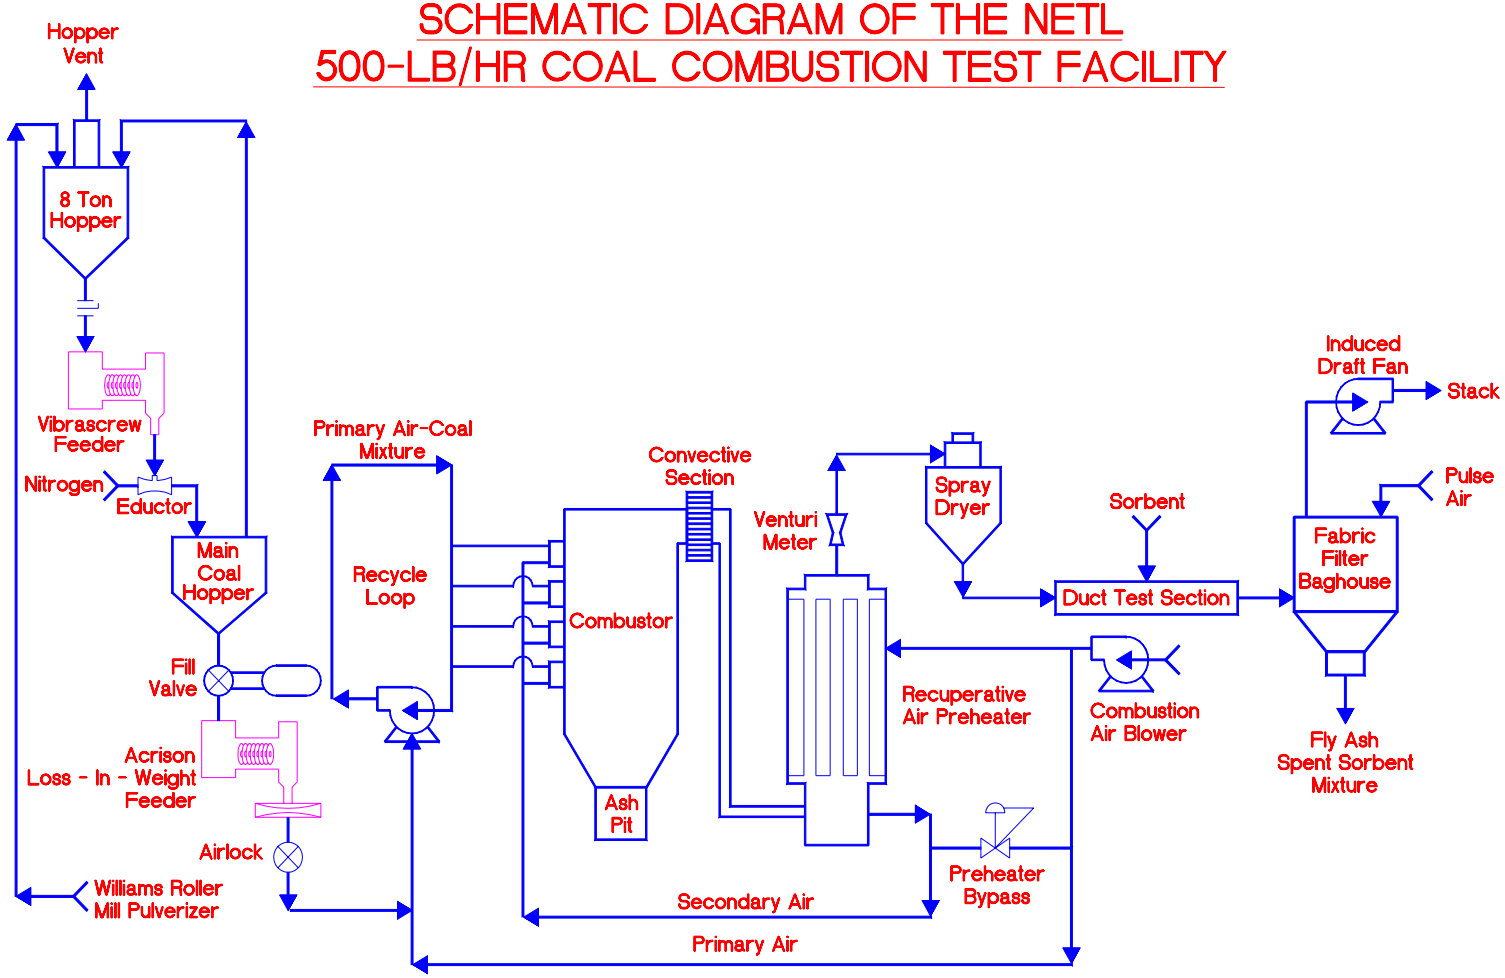

NETL Bench-Scale Results

Significant Level of Mercury Oxidation

- Slipstream of Particulate-Free PRB Flue Gas
- 6 – 50 µg/Nm^3 Elemental Mercury (Spiking)
- Low Power Consumption
- Typically 30-70% Removal of Mercury
- Extremely Low UV Intensity Applied
- Non-Optimized Bench-Scale Apparatus

Powerspan Bench-Scale Results

Commercial Lamp System

- Flow-rate: 24 scfm
- Temperature: 120 - 140°F
- Intensity: 13.8 W/cm^2 -- Low Parasitic Power
- Mercury Concentration: 13.0 µg/Nm^3
- 5.6% O_2, 13% CO_2, 8% H_2O, 1300 ppm SO_2, 220 ppm NO, 20 ppm CO, and balance N_2
- 91% Removal
- Pilot-Scale Tests in 2005

Acknowledgements

- Innovations for Existing Power Plants (IEP) Program
- Tom Feeley
- Dave Wildman
- Bob Kleinmann